




BOILER RESET CONTROLS

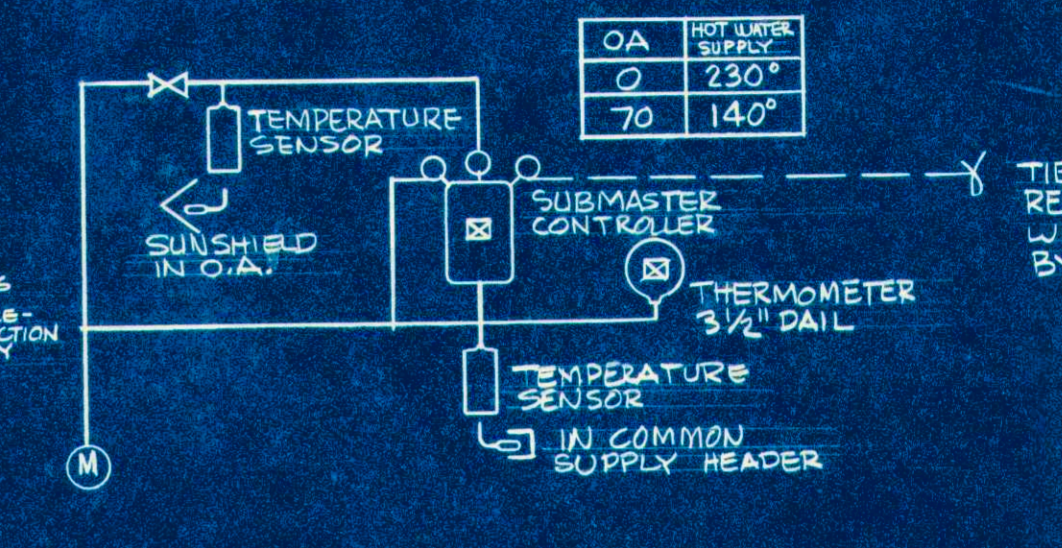


CHILLER CONTROLS

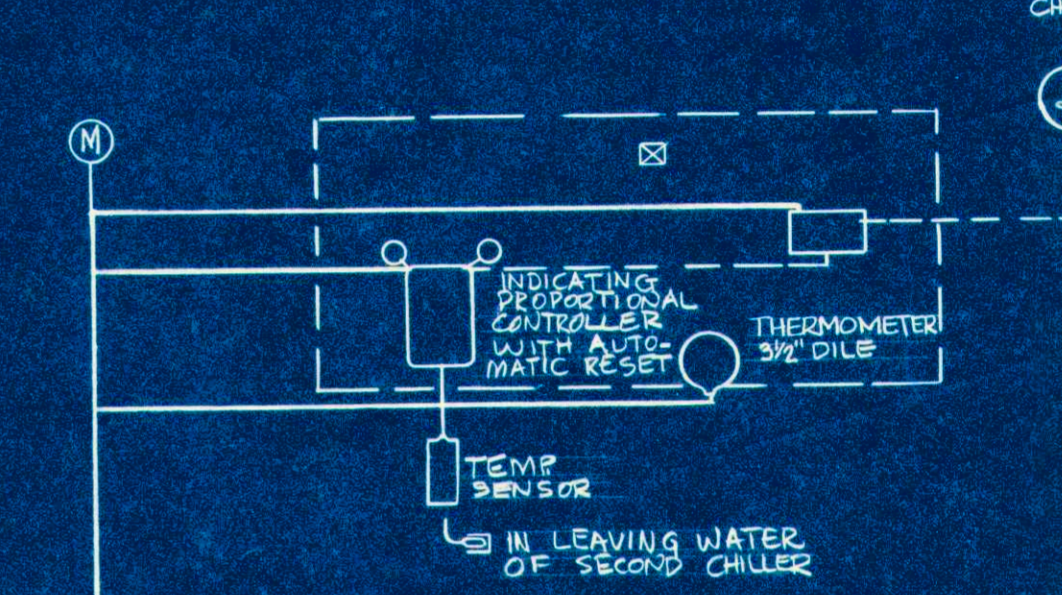


CONDENSER WATER CONTROL

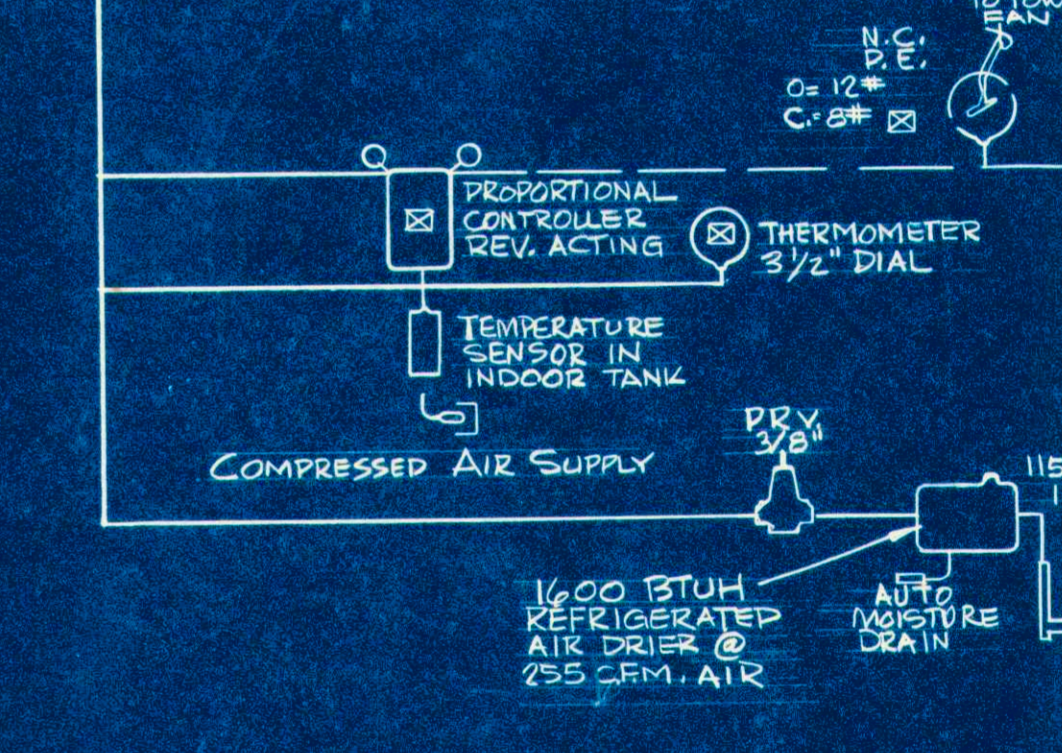

PNEUMATIC CONTROL DIAGRAM

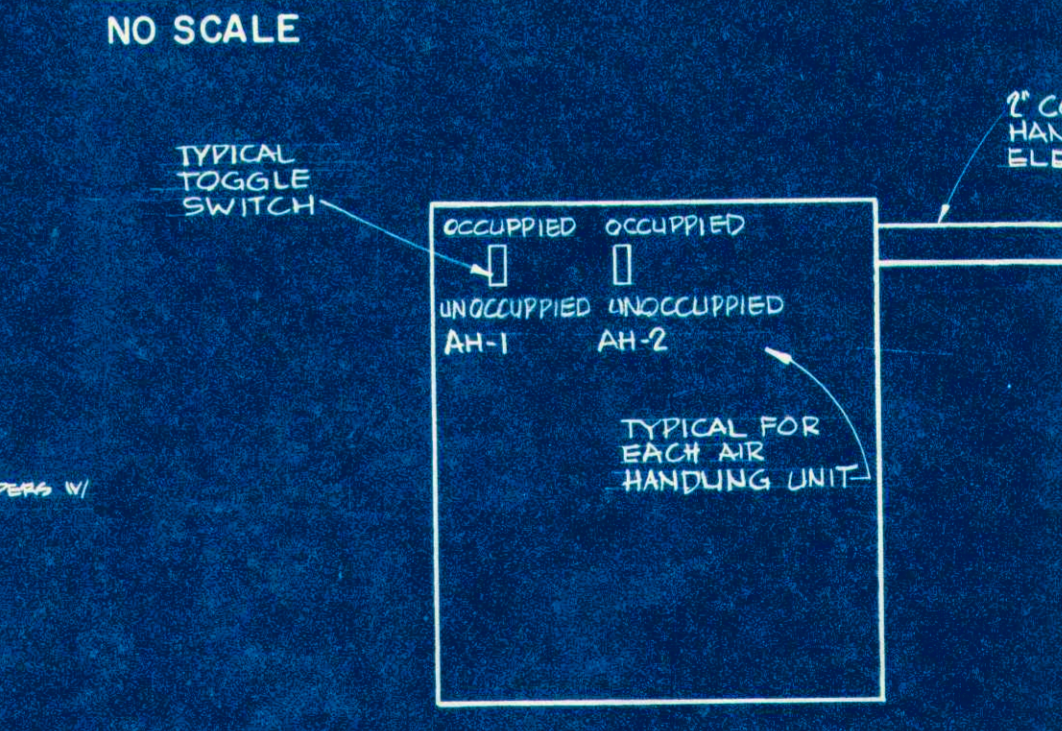

CONTROL ROOM PANEL

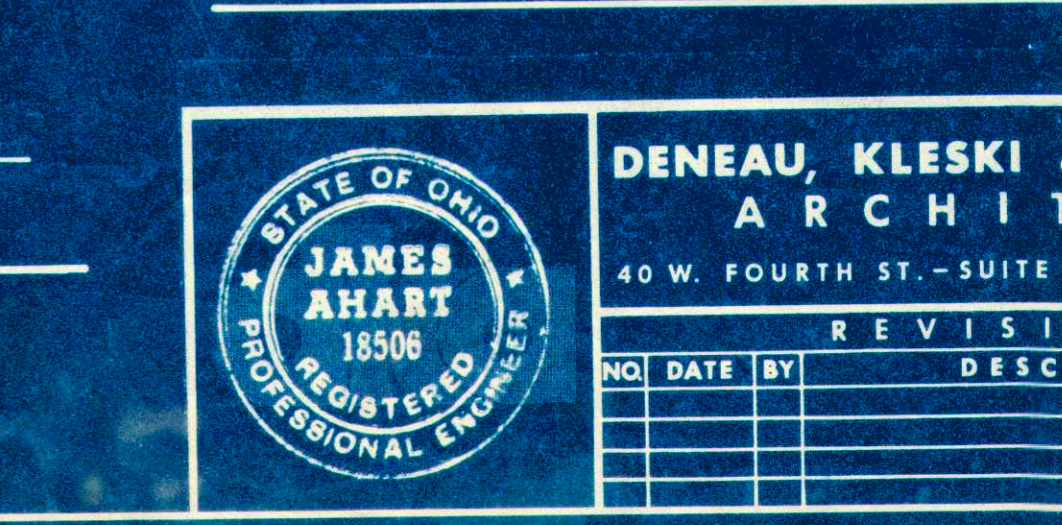

GENERAL CONTROL NOTES

1. ELECTRICIAN TO RUN A 2 INCH CONDUIT FROM SUPPLIES UNOCCUPIED PANEL IN ROOM PANEL TO EACH AIR HANDLING UNIT CONTROL PANEL.

SINGLE ZONE DRAW THROUGH SYSTEMS

NO SCALE

ELECTRIC CONTROL DIAGRAM

NO SCALE



DENEAU, KLESKI & ASSOCIATES
ARCHITECTS
40 W. FOURTH ST. - SUITE 2100 - DAYTON, OHIO

DAYTON EXHIBITION CENTER
FIFTH AND MAIN STREETS
DAYTON OHIO

| REVISIONS | | DATE | COMM. NO. | SHEET NO. |
|-----------|---------|-------------|-----------|-----------|
| NO. | DATE BY | DESCRIPTION | | |
| | | | | |

| | | | | |
|------------|----------|------------|--|--|
| CSE and PS | 11.12.70 | 68007 | | |
| TJF | 11.13.70 | 120, 3/170 | | |

M-12